










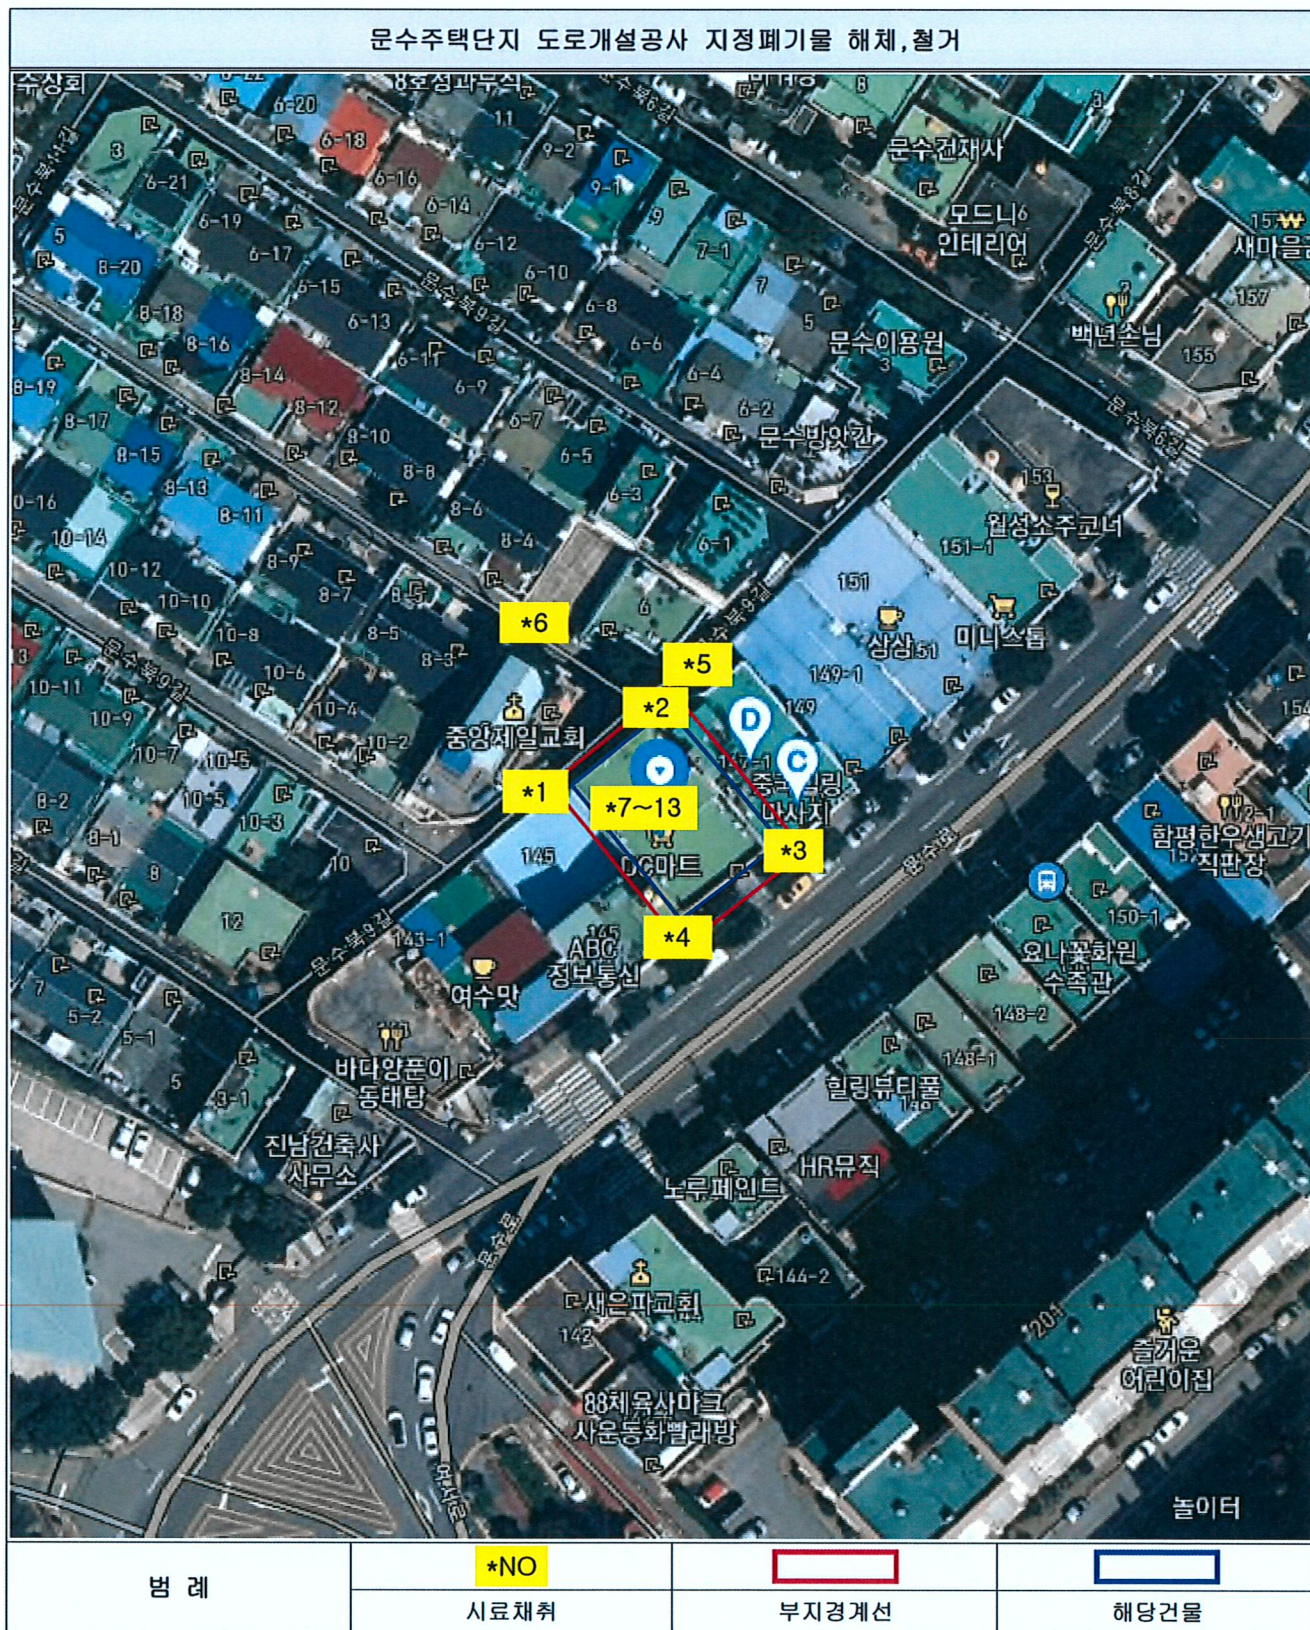















[별 첨1] 측정 위치도(측정 장소)



[별첨2] 측정 결과

시료 번호	측정 지점	측정 장비 (종류/수량)		유량 (ℓ/분)	측정 일시	측정 결과 (f/cc)	비고
1	부지경계선1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
2	부지경계선2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
3	부지경계선3	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
4	부지경계선4	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
5	거주자주거지역1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
6	거주자주거지역2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
7	위생설비입구	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
8	작업장주변	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
9	음압기배출구1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
10	음압기배출구2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
11	음압기배출구3	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
12	폐기물반출구1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/07	불검출 [검출한계 0.002미만]	-
-	공시료	지역시료채취펌프 (SARA-5100)	1	-	-	0개/100개시야	-
-	공시료	지역시료채취펌프 (SARA-5100)	1	-	-	0개/100개시야	-

[별첨3] 측정 사진

측정 지점	시작 사진	종료 사진	시작 사진	종료 사진
부지경계선1 부지경계선2				
	9:30	13:30	9:35	13:35
부지경계선3 부지경계선4				
	9:40	13:40	9:45	13:45
거주자주거지역1 거주자주거지역2				
	9:50	11:50	9:55	11:55
위생설비입구 작업장 주변				
	10:00	10:40	10:00	12:00
음압기배출구1 음압기배출구2				
	10:05	10:45	10:05	10:45
음압기배출구3 폐기물반출구1				
	11:00	11:40	11:05	11:45

[별 첨1] 측정 위치도(측정 장소)



[별첨2] 측정 결과

시료 번호	측정 지점	측정 장비 (종류/수량)	유량 (ℓ/분)	측정 일시	측정 결과 (f/cc)	비고	
1	부지경계선1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
2	부지경계선2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
3	부지경계선3	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
4	부지경계선4	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
5	거주자주거지역1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
6	거주자주거지역2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
7	위생설비입구	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
8	작업장주변	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
9	음압기배출구1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
10	음압기배출구2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
11	음압기배출구3	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
12	음압기배출구4	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
13	음압기배출구5	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
14	폐기물반출구1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
15	폐기물반출구2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	0.003	-
16	폐기물반출구3	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	0.003	-
17	폐기물보관지점1	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
18	폐기물보관지점2	지역시료채취펌프 (SARA-5100)	1	10.00	20/06/09	불검출 [검출한계 0.002미만]	-
-	공시료	지역시료채취펌프 (SARA-5100)	1	-	-	0개/100개시야	-
-	공시료	지역시료채취펌프 (SARA-5100)	1	-	-	0개/100개시야	-

[별첨3] 측정 사진

측정 지점	시작 사진	종료 사진	시작 사진	종료 사진
부지경계선1 부지경계선2				
	8:30	12:30	8:35	12:35
부지경계선3 부지경계선4				
	8:40	12:40	8:45	12:45
가주지주거지역1 가주지주거지역2				
	8:50	10:50	8:55	10:55
위생설비입구 작업장 주변				
	9:00	9:40	9:01	11:01
음압기배출구1 음압기배출구2				
	9:10	9:50	9:45	10:25
음압기배출구3 음압기배출구4				
	9:45	10:25	13:00	13:40

측정 지점	시작 사진	종료 사진	시작 사진	종료 사진
음압기배출구5 폐기물반출구1	 13:00	 13:40	 9:10	 9:50
폐기물반출구2 폐기물반출구3	 9:45	 10:25	 13:05	 13:45
폐기물보관지점1 폐기물보관지점2	 16:00	 16:40	 16:00	 16:40